

Load Frequency Control of multi Area System with the help of ANN and ANFIS based Optimizer

Authors: Mr. Ritesh Bagdi¹, Ms. Neha Shrivastava²

¹ M. Tech Scholar in Power System, REC, Bhopal (M.P). E-mail: (riteshbagdi9@gmail.com)

² Assistant Professor, Electrical & Electronics Dept. REC, Bhopal (M.P). E-mail: (vastavaneha@gmail.com)

Abstract —Load Frequency Control (LFC) are used to regulate and control the output frequency signal of the electric generated power within an area in response to changes in system loads. The gain constants in the case of conventional controllers remain same throughout, for changes in the load value. However, Load cannot be the same throughout, load deviates from time to time. To get rid of these disadvantages related to conventional controllers, a lot many schemes have been put forth in literature. This work presents a new design of various types of load frequency controllers based on different types of Artificial Intelligent (AI) optimization techniques such as Fuzzy logic, ANN tuner for a single area power system. The performance of the controller under study shows an enhancement in the frequency deviation signal as well as the peak overshoot and settling time for the frequency output signal. The performance of the proposed scheme is validated using MATLAB/ SIMULINK tools.

KEYWORDS: *LFC, ANN, ANFIS, PI, Fuzzy, Multi-Area Power System.*

I. INTRODUCTION

As the loading in a power system is not constant so the controllers for the system must be aimed to provide quality service in the power system. The power flow and frequency in an interconnected system is well regulated by AGC. The main purpose of the AGC is to retain the system frequency constant and almost inert to any disturbances. Generally two things are being controlled in AGC i.e. voltage and frequency. Both have separate control loops and independent of each other.

Apart from controlling the frequency the secondary majors is to maintain a zero steady state error and to ensure optimal transient behavior within the

interconnected Areas. The objective is to design a controller to apprehend preferred power flow and frequency in single Area power system.

The input mechanical power is utilized to control the frequency of the generators and the variation in the frequency and tie-line power are detected, which is the extent of the alteration in rotor angle. A decently outlined power framework ought to have the capacity to give the satisfactory levels of power quality by keeping the frequency and voltage size inside middle of as far as possible.

II. LITERATURE REVIEW

[1] In this paper presented that Grids face a new and important challenge: the oncoming mass penetration of plug-in Electrical Vehicles (EVs). Nevertheless, the architectures of transmission and distribution grids are still focused on traditional design and operational rules. Consequently, it is necessary to predict the adequate solutions for the problems which are going to rise to the electrical and production grids as well as the effect on their commercial operation as a result of the gradual integration of EVs into the network. [2] This paper discussed that in renewable penetrated power systems, frequency instability arises due to the volatile nature of renewable energy sources (RES) and load disturbances. The traditional load frequency control (LFC) strategy from conventional power sources (CPS) alone unable to control the frequency deviations caused by the aforementioned disturbances. Therefore, it is essential to modify the structure of LFC, to handle the disturbances caused by the RES and load. [3] This paper discussed that the rapid development of technology used in electric vehicles, and in particular their penetration in electricity networks, is a major challenge for the area of electric power systems. The utilization of battery capacity of the interconnected vehicles can bring

significant benefits to the network via the Vehicle to Grid (V2G) operation. [4] In this paper the use of the proportional integral (PI) algorithm incorporated with the fuzzy logic technique has been proposed as advanced gain scheduling load frequency control (GLFC) in two-area power systems. The proposed controller comprises two-level control systems, such that it consists of a pure integral compensator, which is connected, in parallel with a PI controller. However, and based on load demand, the PI parameters are updated online by means of fuzzy logic rules. With this control technique, it becomes possible to eliminate steady state errors as well as to maintain good transient responses. The task of keeping a stable and overall satisfactory mode of operation in interconnected electric power systems is the main goal of any control strategy. [5] This study aims to develop a Load Frequency Control (LFC) for a single area power system using a fuzzy logic tuned PI controller. A deviation of frequency value from the standard ($\pm 0.5\text{Hz}$) arises when real power generation fails to supply demand along with network losses. Various LFC studies have been done exploiting control strategies ranging from classical control schemes to soft analysis techniques. [6] This paper discussed in this paper the Artificial Neural Network (ANN) Controller for load frequency control of Multi area power system is presented. The performances of ANN Controller and conventional PI controllers are compared for Single area and Multi area power system with non-reheat turbines. [7] This paper discussed a control scheme of ANN based proportional integral-derivative (PID) controller is developed here to maintain the system frequency at nominal value. Due to some complication of modern industrial system, the conventional PID controller is not capable to meet our requirement. Neural network is have great capability in solving complex, nonlinear mathematical problems. This paper introduces the design of neuro-PID controller model to improve the response and performance of conventional PID controller. [8] In this paper, a hybrid combination of Neuro and Fuzzy is proposed as a controller to solve the Automatic Generation Control (AGC) problem in a restructured power system that operates under deregulation pedestal on the bilateral policy. In each control area, the effects of the possible contracts are treated as a set of new input signal in a modified traditional dynamical model. The prominent advantage of this strategy is its high insensitivity to large load changes and disturbances in the presence of plant parameter discrepancy and system

nonlinearities. [9] This paper discussed that Load frequency control (LFC) is required for reliable operation of a large interconnected power system. The main work of load frequency control is to regulate the power output of the generator within a specified area with respect to change in the system frequency and tie-line power; such as to maintain the scheduled system frequency and power interchange with other areas in a prescribe limits. In this paper, study of LFC system for single area. [10] This paper discussed while the number of internal combustion vehicles is stagnating, and is even expected to decrease in a few decades, the amount of electric vehicles is predicted to increase. Most of the electric cars are designed for daily urban use, thus in the near future, bigger cities might have some ten percentage of electric cars running on their streets during the day.

III. LOAD FREQUENCY CONTROL

With many loads linked to a system in a power system, speed and frequency vary with the characteristics of the governor with variations in loads. No need to modify the setting of the generator if maintaining of constant frequency is not needed. When constant frequency is needed the turbine speed can be adjusted by varying the governor characteristic.

Let both generating stations are interconnected through a tie line. If load varies at X or Y & A generation has to maintain the constant frequency, at that time it is known as Flat Frequency Regulation.

- Secondly, where both X & Y have to maintain the constant frequency. It is known as parallel frequency regulation.
- Thirdly where frequency maintenance is done of a certain Area by its own generator & keeping constant the tie-line loading. It is called flat tie-line loading control.
- In Selective Frequency control, individually system handles the variation in load itself & without interfering, beyond its limits, the maintenance of the other one in that group.

In Tie-line Load-bias, control all systems in the interconnection help in maintaining frequency no matter where the variation is created. It has a principal load frequency controller & a tie line plotter determining input power on the tie for proper control of frequency.

iv. METHODOLOGY

- ANN

Machine learning technique is not new to the field of science and technology. It has been utilized by various fields to solve complex algorithmic problems. With its excellent development, it has found its way in the field of electrical engineering also. It has been widely used for load forecasting, stability analysis, in solving economic load dispatch etc. to name a few of them. Due to its strong learning ability, expert systems are easily overtaking digital techniques. Techniques like ANN, ANFIS etc, which are different forms of machine learning, prove to be very reliable along with providing fast results.

The ANN has advanced methods such as optimal control, adaptive control, multi-variable control and different approaches such as microprocessor based controllers and digital signal processing have been investigated or under investigation.

- ANFIS

ANFIS stands for Adaptive Neuro-Fuzzy Inference System. The ANFIS controller combines the advantages of fuzzy controller as well as quick response and adaptability nature of ANN. Fundamentally, ANFIS is about taking a fuzzy inference system (FIS) and tuning it with a back propagation algorithm based on some collection of input-output data. This allows your fuzzy systems to learn. A network structure facilitates the computation of the gradient vector for parameters in a fuzzy inference system. Once the gradient vector is obtained, a number of optimization routines is applied to reduce an error measure (usually defined by the sum of the squared difference between actual and desired outputs). This process is called learning by example in the neural network literature.

- Some Constraints are as follows:-

Since ANFIS is much more complex than the fuzzy inference systems discussed so far, all the available fuzzy inference system options cannot be used. Specifically, ANFIS only supports Sugeno systems subject to the following constraints:

- First, order Sugeno-type systems.
- Single output derived by weighted average defuzzification.

- Unity weight for each rule.

An error occurs if your FIS matrix for ANFIS learning does not comply with these constraints. Moreover, ANFIS is highly specialized for speed and cannot accept all the customization options that basic fuzzy inference allows, that is, one cannot make own membership functions and defuzzification functions; that to make do with the ones provided.

The fuzzy inference system that has been considered is a model that maps:

- – Input characteristics to input membership functions,
- – Input membership function to rules,
- – Rules to a set of output characteristics,
- – Output characteristics to output membership functions, and
- – The output membership function to a single-valued output, or
- – A decision associated with the output.

The inputs are ACE and Change in ACE. We have studied above the Fuzzy rule base and formed the rules. Two linguistic variables of the inputs and 2 linguistic variables of the output using the NeuroFuzzyAnalyzer toolbox. The membership functions used are

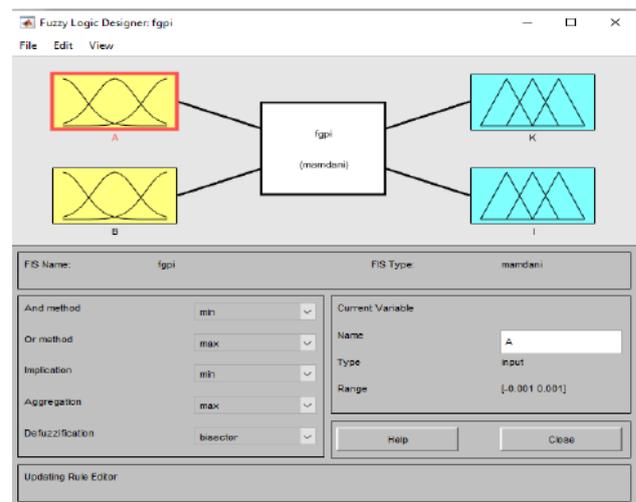


Fig 1 Fuzzy Logic Designer

V. RESULT

In this section ANN, based PI tuner controller results are discussed. Below figure 2 shows the Simulink model for it. The ANN model is trained and tested

with neural network toolbox in MATLAB only. The model is prepared with data collected from PID model simulation. Input data consist of ACE and change in ACE and output data consist of Proportional gain and integral gain value. 85% of data is used for training 5% for validation and 10% for testing. The overall regression has a value of more than 0.9 that is considered as good value for any training. Post development of model in neural network toolbox, its Simulink model is prepared from same GUI.

Figure 3 displays the output signal of Change in frequency response of DC motor using ANN-PI controller.

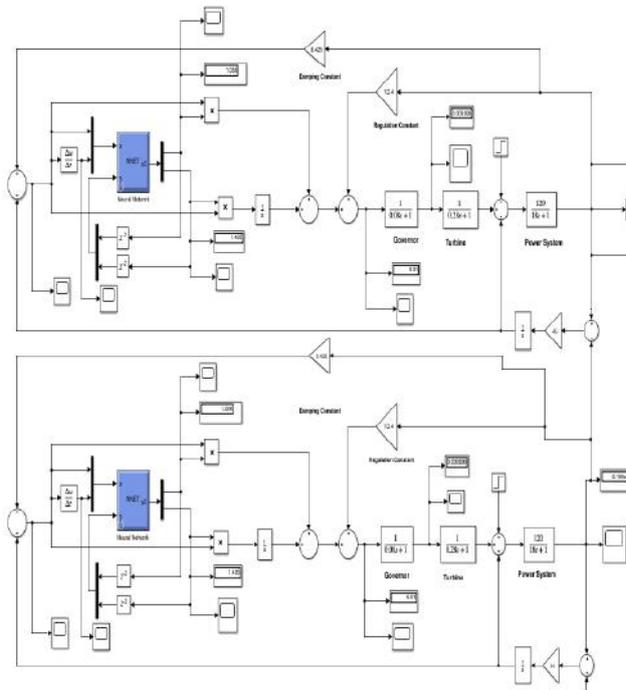


Fig 2 Simulink model of LFC using ANN-PI controller

The above fig 2 shows the Simulink model for load frequency control using ANN-PI controller.



Fig 3 Change in frequency (Δf) response for ANN-PI controller.

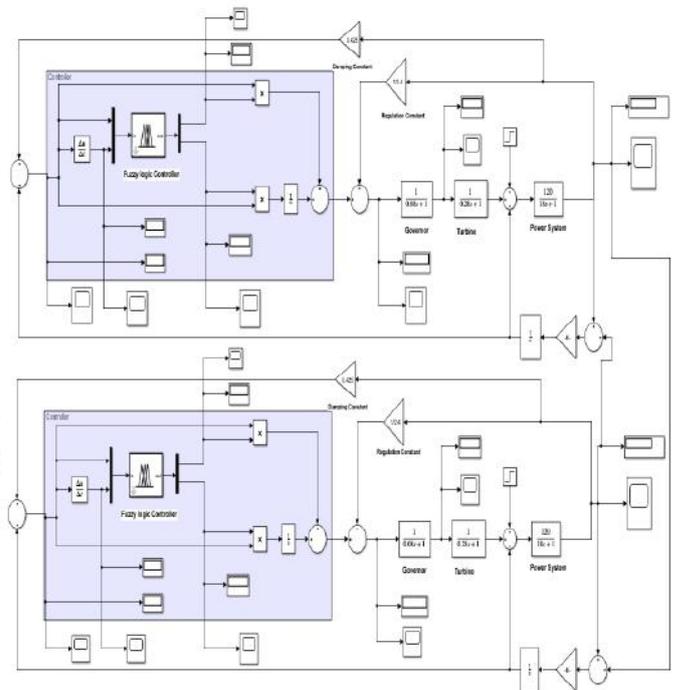


Fig 4 Simulink model of LFC using ANFIS controller

The above figure 4 shows the Simulink model for load frequency control using ANFIS controller. The output signal from controller block after subtracting from frequency regulator value is supplied to Governor Block. The output from this block is then provided to turbine block. The output of this block, after subtracting change in power value is supplied to power system block to regulate output power so that frequency is maintained at constant value.



Fig 5 Change in frequency (Δf) response for ANFIS controller.

Figure 5 displays the output signal of Change in frequency response using ANFIS controller.

Table 1 shows the value of LFC response parameters for ANN and ANFIS controller. Based on this parameters the comparison between two controllers will be done to check there performance

Table 1

Parameters	ANN	ANFIS
Rise Time (Sec):	1.9877e-05	3.7420e-05
Settling Time (Sec):	11.9946	10.5160
Settling Min (Hz):	-0.0192	0.0202
Settling Max (Hz):	0.0058	0.0045
Overshoot:	8.8382e+06	1.4082e+06
Undershoot:	2.6515e+06	3.1419e+05
Peak (Hz):	0.0192	0.0202
Peak Time (Sec):	5.3776	5.5464

VI. CONCLUSION

The performance of the controllers under study are tested and validated using MATLAB/SIMULINK tools. On comparison, it is found that ANFIS has minimum settling time and minimum percentage overshoot out of the two. The simulation results proof that the new techniques is succeeded to improve the controller performance.

REFERENCES

[1] Anestis G. Anastasiadis, Georgios P. Kondylis, Apostolos Polyzakis, Georgios Vokas, "Effects of Increased Electric Vehicles into a Distribution Network", Technologies and Materials for Renewable Energy, Environment and Sustainability, TMREES18, Athens, Greece, PP 586–593, Energy Procedia 157, ScienceDirect, 2019.
DOI: 10.1016/j.egypro.2018.11.223

[2] Anil Annamraju and Srikanth Nandiraju, "Coordinated control of conventional power sources and PHEVs using jaya algorithm optimized PID controller for frequency control of a renewable penetrated power system", Protection and Control of Modern Power Systems, Springer open, 2019.

DOI: <https://doi.org/10.1186/s41601-019-0144-2>

[3] Neofytos Neofytou, Konstantinos Blazakis, Yiannis Katsigiannis, and Georgios Stavrakakis, "Modeling Vehicles to Grid as a Source of Distributed Frequency Regulation in Isolated Grids with Significant RES Penetration", Energies 2019, volume 12, mdpi journals, 2019.
DOI: 10.3390/en12040720

[4] Tawfiq Hussein and Awad Shamekh, "Design of PI Fuzzy Logic Gain Scheduling Load Frequency Control in Two-Area Power Systems", Designs 2019, Volume 3, Edition 26, mdpi journals, 2019.
DOI: 10.3390/designs3020026

[5] T. Mohammed, J. Momoh and A. Shukla, "Single area load frequency control using fuzzy-tuned PI controller," 2017 North American Power Symposium (NAPS), Morgantown, WV, pp. 1-6, IEEE, 2017.
DOI: 10.1109/NAPS.2017.8107352.

[6] S. Jennathu Beevil, R. Jayashree, S. Shameer Kasim, "ANN Controller For Load Frequency Control", International Journal for Research in Applied Science & Engineering Technology (IJRASET), Volume 4 Issue I, 2016.

[7] V. S. Sundaram and T. Jayabarathi, "Load Frequency Control using PID tuned ANN controller in power system," 2011 1st International Conference on Electrical Energy Systems, Newport Beach, CA, pp. 269-274, 2011.
DOI: 10.1109/ICEES.2011.5725341.

[8] S. Baghya Shree, N. Kamaraj, "Hybrid Neuro Fuzzy approach for automatic generation control in restructured power system", Electrical Power and Energy Systems 74, pp. 274–285, Elsevier, 2016.
DOI: <http://dx.doi.org/10.1016/j.ijepes.2015.05.029>

[9] D. K. Sambariya and Vivek Nath, "Load Frequency Control Using Fuzzy Logic Based Controller for Multi-area Power System", British Journal of Mathematics & Computer Science", 13(5), PP. 1-19, SCIEDOMAIN international, 2016.
DOI: 10.9734/BJMCS/2016/22899

[10] G. Chun-lin, W. Li, W. Dan, Q. Wen-bo and X. Xiang-ning, "Impact of electric vehicle charging on power grid," International Conference on Electrical and Control Engineering, Yichang, 2011, pp. 2270-2274, IEEE, 2011.

DOI: 10.1109/ICECENG.2011.6057167.

[11] S. K. Jain, A. Bhargava and R. K. Pal, "Three area power system load frequency control using fuzzy logic controller," 2015 International Conference on Computer, Communication and Control (IC4), Indore, pp. 1-6, IEEE, 2015.
DOI: 10.1109/IC4.2015.7375614.

[12] H. Shayeghi, H. A. Shayanfar, "Application of ANN Technique for Interconnected Power System Load Frequency Control", 2015 International Conference on Computer, Communication and Control (IC4), 2015.

[13] S. K. Jain, A. Bhargava and R. K. Pal, "Three area power system load frequency control using fuzzy logic controller," 2015 International Conference on Computer, Communication and Control (IC4), Indore, 2015, pp. 1-6, IEEE, 2015.
DOI: 10.1109/IC4.2015.7375614.

[14] Poonam Rani, Mr. Ramavtar Jaswal, "Automatic load frequency control of multi-area power system using ANN controller and Genetic algorithm", International Journal of Engineering Trends and Technology (IJETT) – Volume 4 Issue 9, 2013.

[15] David B. Richardson, "Electric vehicles and the electric grid: A review of modeling approaches, Impacts, and renewable energy integration", Renewable and Sustainable Energy Reviews 19, pp 247–254, Elsevier, 2013.
DOI: <http://dx.doi.org/10.1016/j.rser.2012.11.042>

[16] K. A. Ellithy, K.A. El-Metwally, "Design of Decentralized Fuzzy Logic Load Frequency Controller", I.J. Intelligent Systems and Applications, MECS volume 2, pp 66-75, 2012.
DOI: 10.5815/ijisa.2012.02.08

[17] S. Prakash and S. K. Sinha, "Four area Load Frequency Control of interconnected hydro-thermal power system by Intelligent PID control technique," 2012 Students Conference on Engineering and Systems, Allahabad, Uttar Pradesh, pp. 1-6, IEEE, 2012.
DOI: 10.1109/SCES.2012.6199090.

[18] V. S. Sundaram and T. Jayabarathi, "Load Frequency Control using PID tuned ANN controller in power system," 2011 1st International Conference

on Electrical Energy Systems, Newport Beach, CA, pp. 269-274, IEEE 2011.

DOI: 10.1109/ICEES.2011.5725341.

[19] G. Chun-lin, W. Li, W. Dan, Q. Wen-bo and X. Xiang-ning, "Impact of electric vehicle charging on power grid," 2011 International Conference on Electrical and Control Engineering, Yichang, 2011, pp. 2270-2274, IEEE, 2011.
DOI: 10.1109/ICECENG.2011.6057167.

[20] Surya Prakash, S K Sinha, "Artificial Intelligent & PI in Load Frequency Control of Interconnected Power system", International Journal of Computer Science & Emerging Technologies, Volume 1, Issue 4, 2010.

[21] A. Salami, S. Jadid, N. Ramezani, "The Effect of load frequency controller on load pickup during restoration", in: 1st International Power and Energy Conference, PECON 2006, pp. 225–228, 2006.

[22] D.K. Sambariya, V. Nath, "Load frequency control using fuzzy logic based controller for multi-area power system", Brit. J. Math. Comput. Sci., PP 1–19, 2016.

[23] Mohamed M. Ismail, M.A. Moustafa Hassan, "Artificial intelligence based load frequency controllers for different multi areas power", Int. J. Control Autom. Syst. 1, 2012.

[24] V. Nath, D.K. Sambariya, "Application of NARMA L2 controller for load frequency control of multi-area power system", in: IEEE Proceeding of 10th International Conference on Intelligent Systems and Control (ISCO 2016), vol. 2, pp. 352–358, 2016.

[25] Emre Ozkop, Ismail H. Altas, Adel M. Sharaf, "Load frequency control in four area power systems using fuzzy logic PI controller", in: 16th National Power Systems Conference, 15th– 17th December, 2010.

[26] Sukhwinder Singh Dhillona, Jagdeep Singh Latherb, Sanjay Marwahac, "Multi area load frequency control using particle swarm optimization and fuzzy rules", in: 3rd International Conference on Recent Trends in Computing (ICRTC), pp. 460–472, 2015.

[27] Surya Prakash, Sunil Kumar Sinha, "Four area Load Frequency Control of interconnected hydro-

thermal power system by Intelligent PID control technique", 2012.

[28] S. Priyadharshini, P. Vanitha, "*Four area interconnected system on load frequency control using firefly algorithm*", Int. J. Adv. Res. Electric. Electron. Eng. 3 , ISSN_NO: 2321-4775, 2014.

iJournals